


1106 Achievement ratio of conformable water based on odor of chlorine (%)

Achievement ratio of conformable water based on odor of chlorine = $\{1 - (\text{Maximum residual chlorine concentration} - \text{Target residual chlorine concentration}) / \text{Target residual chlorine concentration}\} \times 100 (\%)$

If a calculated value is less than 0%, this PI value is 0%.

If a calculated value is more than 100%, this PI value is 100%.

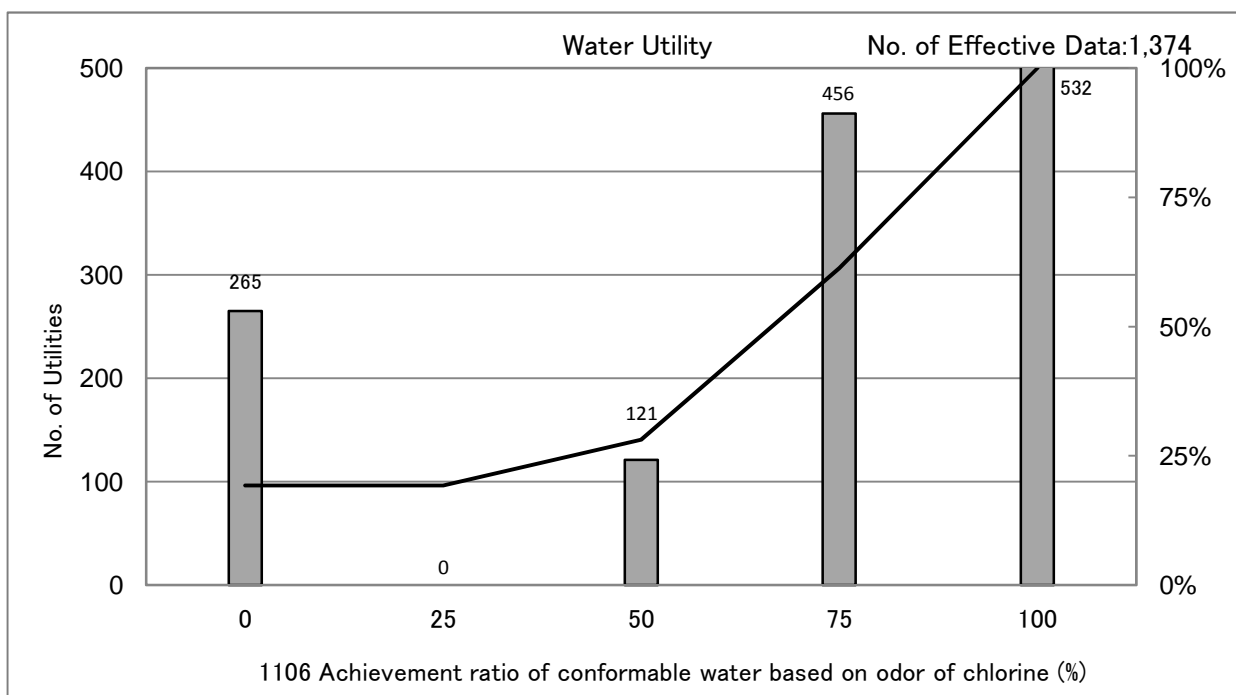

[Percentile Value] Water Utility

Fiscal year

F.Y.	95%	75%	50%	25%	5%
2008	100	100	75	25	0
2009	100	100	75	25	0
2010	100	100	75	25	0
2011	100	100	75	25	0
2012	100	100	75	25	0

Measurement Material	Target
Residual Chlorine	0.4mg/L

Population supplied (F.Y.2012)

People	95%	75%	50%	25%	5%
<=1	100	100	100	50	0
1-3	100	100	75	50	0
3-10	100	100	75	25	0
10-50	100	75	50	0	0
50<	75	50	25	0	0

× 10,000people

[Scatter Plot]

