


[Reference Data] 1115 Direct supply from distribution main (%)

Direct supply from distribution main = Number of direct connection users [case]

/ Total number of users [case] x 100 (%)

This PI intends for buildings more than 3rd floor.

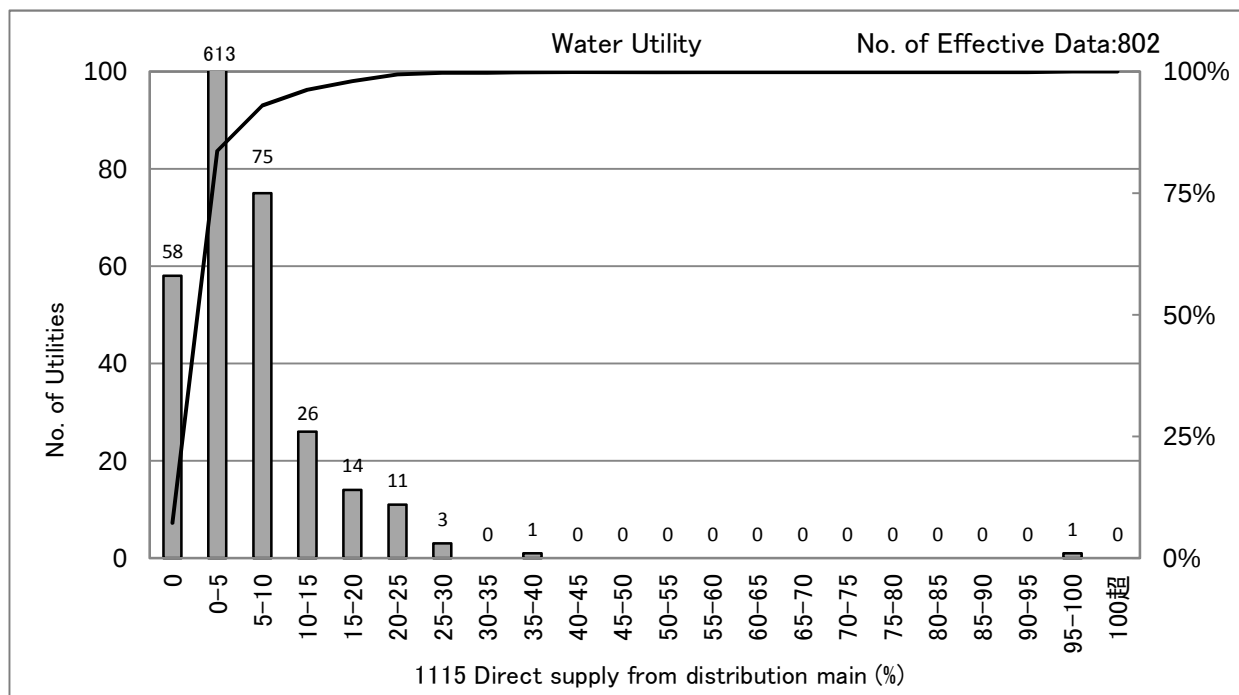

[Percentile Value] Water Utility

Fiscal year

F.Y.	95%	75%	50%	25%	5%
2008	11.2	2.9	0.8	0.2	0.0
2009	11.6	2.9	0.9	0.2	0.0
2010	11.6	3.0	0.9	0.2	0.0
2011	11.6	3.0	0.9	0.1	0.0
2012	11.9	3.1	0.9	0.1	0.0

Population supplied (F.Y.2012)

People	95%	75%	50%	25%	5%
<=1	8.3	3.2	0.9	0.1	0.0
1-3	9.9	2.9	0.9	0.1	0.0
3-10	9.1	2.0	0.6	0.1	0.0
10-50	16.2	4.8	1.6	0.4	0.0
50<	28.2	17.5	11.0	6.1	0.2

× 10,000people

[Scatter Plot]

