


2101 Aging of water treatment facilities (%)

Aging of water treatment facilities = Capacity of purification facilities exceeding statutory
useful life[m³/day] / Capacity of all purification facilities[m³/day] x 100 (%)

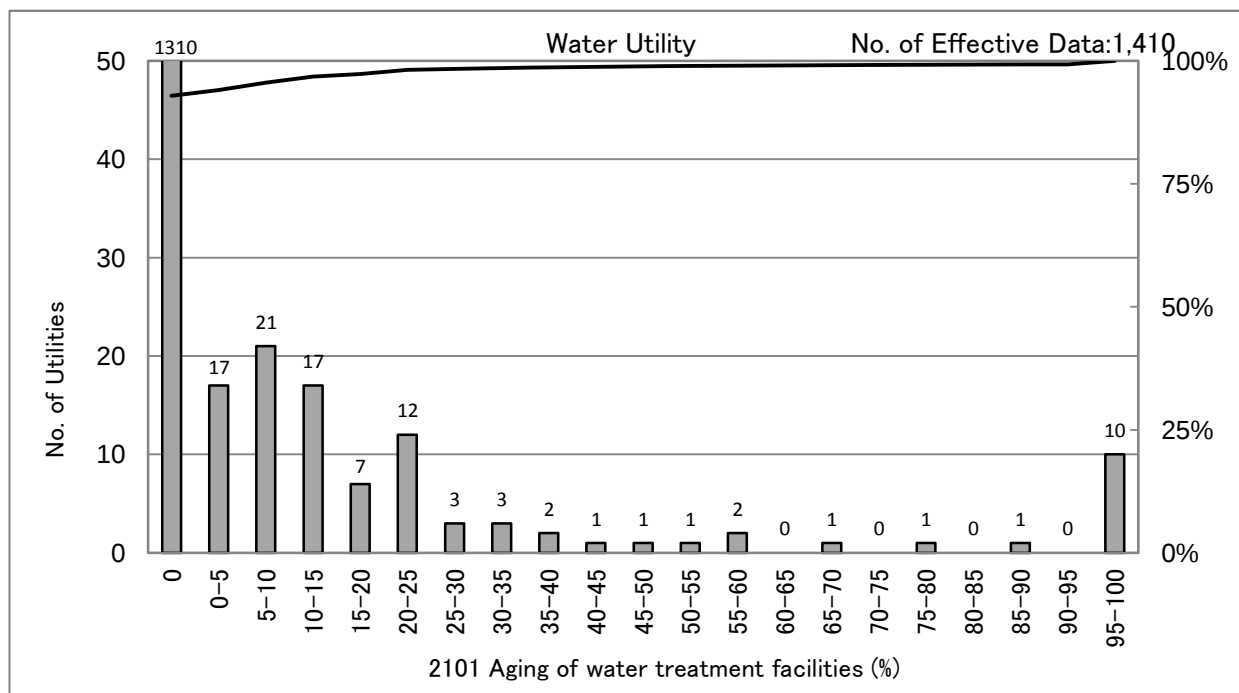


[Percentile Value] Water Utility
Fiscal year

F.Y.	95%	75%	50%	25%	5%
2008	8.6	0.0	0.0	0.0	0.0
2009	8.5	0.0	0.0	0.0	0.0
2010	7.9	0.0	0.0	0.0	0.0
2011	7.5	0.0	0.0	0.0	0.0
2012	7.9	0.0	0.0	0.0	0.0

Population supplied (F.Y.2012)

People	95%	75%	50%	25%	5%
<=1	0.0	0.0	0.0	0.0	0.0
1-3	0.0	0.0	0.0	0.0	0.0
3-10	4.5	0.0	0.0	0.0	0.0
10-50	14.7	0.0	0.0	0.0	0.0
50<	16.8	6.3	0.0	0.0	0.0

× 10,000people

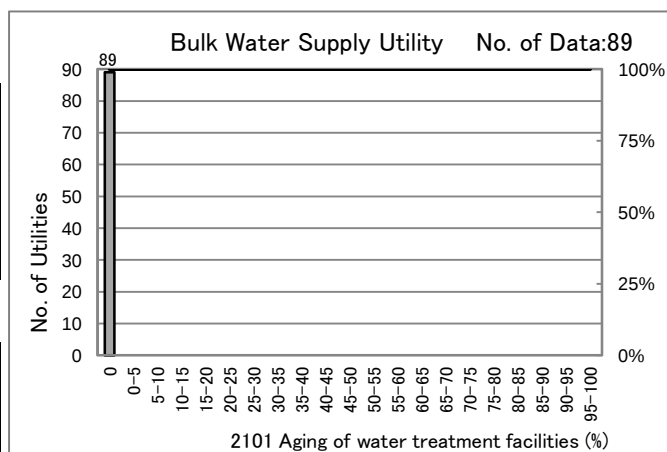

[Percentile Value]	F.Y.	95%	75%	50%	25%	5%
Bulk Water	2009	0.0	0.0	0.0	0.0	0.0
Supply Utility	2010	0.0	0.0	0.0	0.0	0.0
	2011	0.0	0.0	0.0	0.0	0.0
	2012	0.0	0.0	0.0	0.0	0.0

[Scatter Plot]

