


2207 Ratio of earthquake-resistant treatment facility (%)

Ratio of earthquake-resistant treatment facility = Capacity of earthquake-resistant purification facilities[m³/day] / Capacity of all purification facilities[m³/day] x 100 (%)

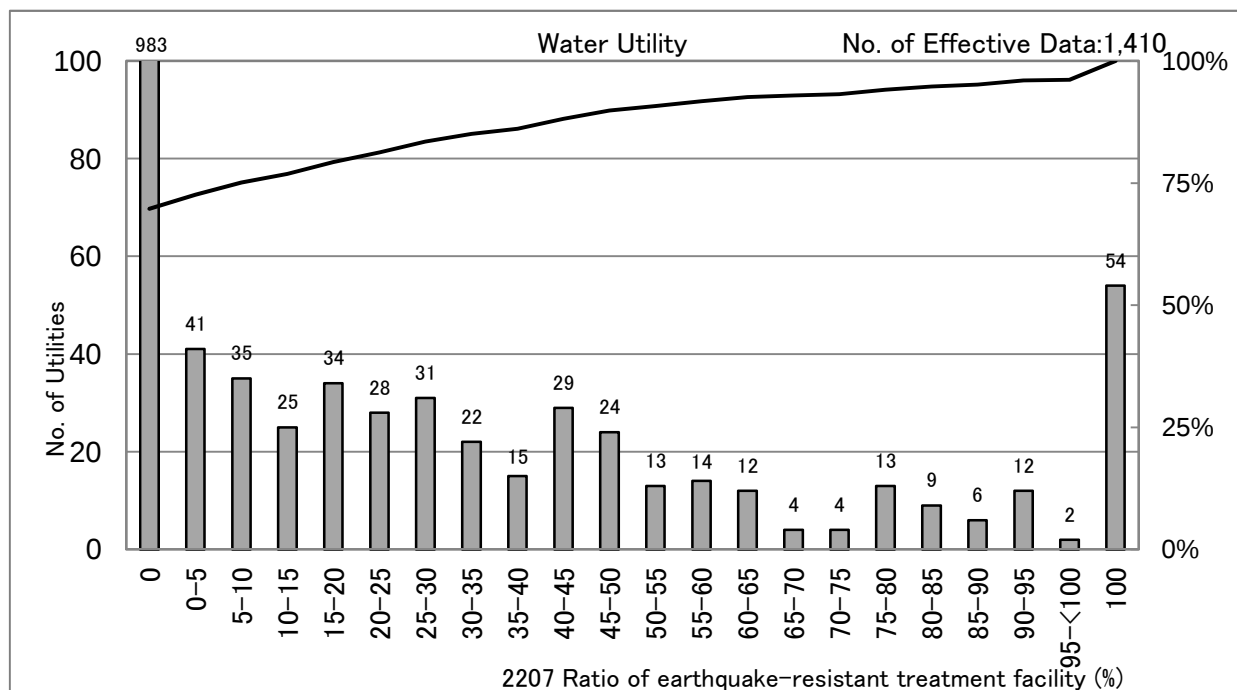


[Percentile Value] Water Utility
Fiscal year

F.Y.	95%	75%	50%	25%	5%
2008	69.7	0.0	0.0	0.0	0.0
2009	72.2	0.0	0.0	0.0	0.0
2010	81.6	2.8	0.0	0.0	0.0
2011	83.2	6.9	0.0	0.0	0.0
2012	87.9	10.0	0.0	0.0	0.0

Population supplied (F.Y.2012)

People	95%	75%	50%	25%	5%
<=1	100.0	0.0	0.0	0.0	0.0
1-3	78.6	0.0	0.0	0.0	0.0
3-10	89.2	19.5	0.0	0.0	0.0
10-50	48.6	18.0	0.0	0.0	0.0
50<	63.5	18.5	9.1	0.0	0.0

x 10,000people

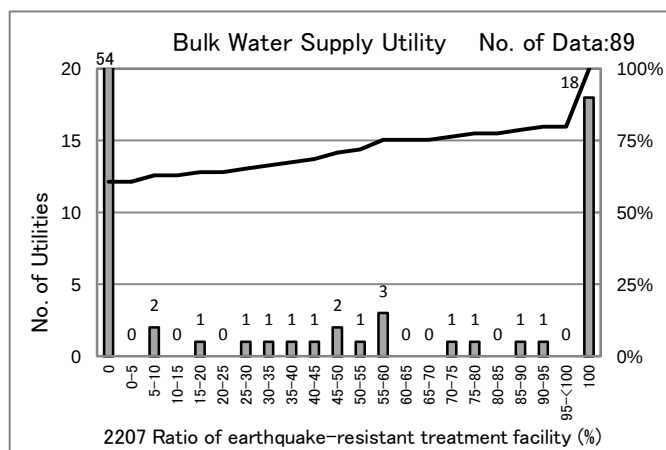

[Percentile Value]	F.Y.	95%値	75%値	50%値	25%値	5%値
Bulk Water	2009	100.0	33.2	0.0	0.0	0.0
Supply Utility	2010	100.0	47.6	0.0	0.0	0.0
	2011	100.0	55.5	0.0	0.0	0.0
	2012	100.0	56.1	0.0	0.0	0.0

[Scatter Plot]

