


4004 Recycling ratio of generated sludge from purification plants (%)

Recycling ratio of generated sludge from purification plants = Amount of used sludge[t-DS]
/ Amount of deposited sludge[t-DS] x 100 (%)

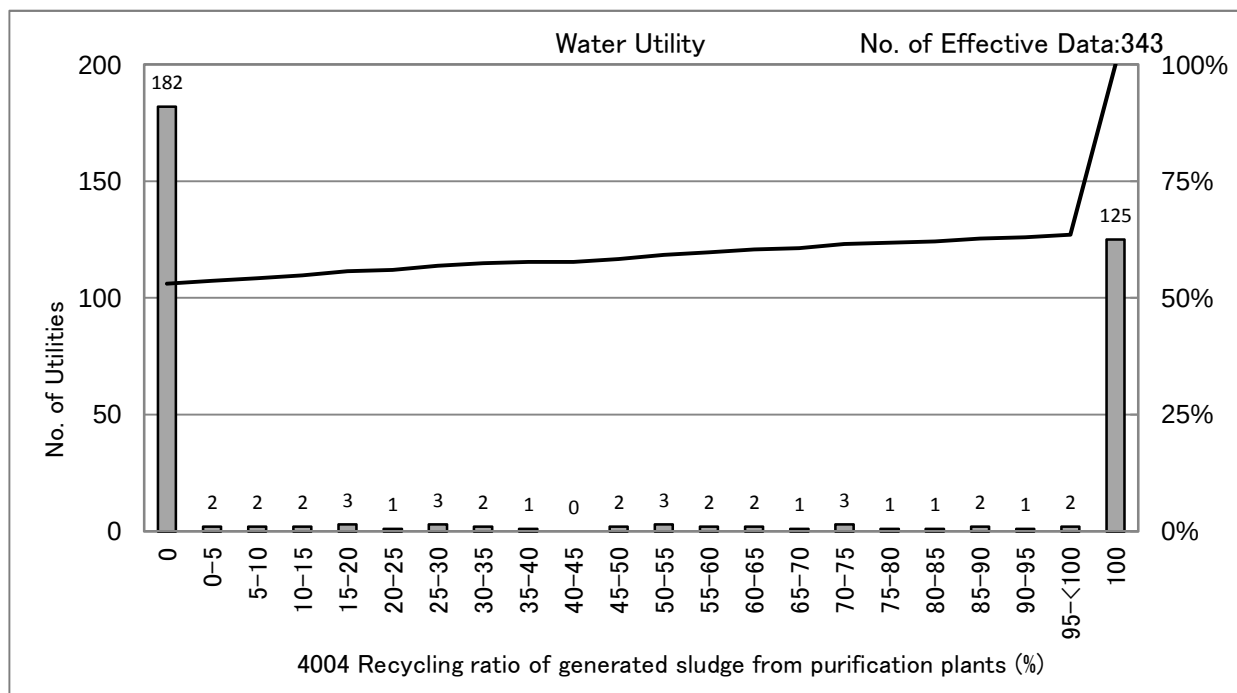


[Percentile Value] Water Utility
Fiscal year

F.Y.	95%	75%	50%	25%	5%
2008	100.0	100.0	0.0	0.0	0.0
2009	100.0	100.0	0.0	0.0	0.0
2010	100.0	100.0	0.0	0.0	0.0
2011	100.0	100.0	0.0	0.0	0.0
2012	100.0	100.0	0.0	0.0	0.0

Population supplied (F.Y.2012)

People	95%	75%	50%	25%	5%
<=1	95.5	0.0	0.0	0.0	0.0
1-3	100.0	100.0	0.0	0.0	0.0
3-10	100.0	100.0	0.0	0.0	0.0
10-50	100.0	100.0	44.8	0.0	0.0
50<	100.0	100.0	89.8	20.9	0.0

× 10,000people

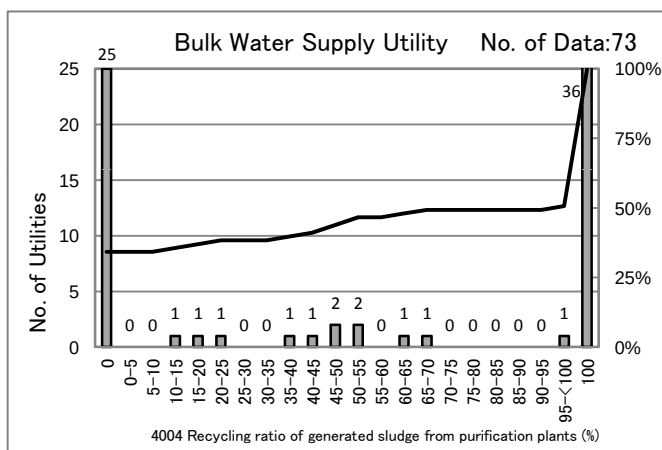

[Percentile Value]	F.Y.	95%	75%	50%	25%	5%
Bulk Water	2009	100.0	100.0	100.0	0.0	0.0
Supply Utility	2010	100.0	100.0	100.0	62.0	0.0
	2011	100.0	100.0	100.0	0.0	0.0
	2012	100.0	100.0	96.6	0.0	0.0

[Scatter Plot]

